



**MINISTRY OF BUSINESS,  
INNOVATION & EMPLOYMENT**  
HĪKINA WHAKATUTUKI

# **Acceptable Solutions and Verification Methods**

For New Zealand Building Code Clause  
**F6 Visibility in Escape Routes**



## Status of Verification Methods and Acceptable Solutions

Verification Methods and Acceptable Solutions are prepared by the Ministry of Business, Innovation and Employment in accordance with section 22 of the Building Act 2004. Verification Methods and Acceptable Solutions are for use in establishing compliance with the New Zealand Building Code.

A person who complies with a Verification Method or Acceptable Solution will be treated as having complied with the provisions of the Building Code to which the Verification Method or Acceptable Solution relates. However, using a Verification Method or Acceptable Solution is only one method of complying with the Building Code. There may be alternative ways to comply.

Users should make themselves familiar with the preface to the New Zealand Building Code Handbook, which describes the status of Verification Methods and Acceptable Solutions and explains alternative methods of achieving compliance.

Defined words (italicised in the text) and classified uses are explained in Clauses A1 and A2 of the Building Code and in the Definitions at the start of this document.

Enquiries about the content of this document should be directed to:



**MINISTRY OF BUSINESS,  
INNOVATION & EMPLOYMENT**  
HĪKINA WHAKATUTUKI

Ministry of Business, Innovation and Employment  
PO Box 1473, Wellington 6140  
Telephone 0800 242 243  
Email: [info@building.govt.nz](mailto:info@building.govt.nz)

**Verification Methods and Acceptable Solutions  
are available from [www.building.govt.nz](http://www.building.govt.nz)**

## New Zealand Government

© Ministry of Business, Innovation and Employment 2016

This document is protected by Crown copyright, unless indicated otherwise. The Ministry of Business, Innovation and Employment administers the copyright in this document. You may use and reproduce this document for your personal use or for the purposes of your business provided you reproduce the document accurately and not in an inappropriate or misleading context. You may not distribute this document to others or reproduce it for sale or profit.

The Ministry of Business, Innovation and Employment owns or has licences to use all images and trademarks in this document. You must not use or reproduce images and trademarks featured in this document for any purpose (except as part of an accurate reproduction of this document) unless you first obtain the written permission of the Ministry of Business, Innovation and Employment.

## Document Status

The most recent version of this document (Amendment 4), as detailed in the Document History, is approved by the Chief Executive of the Ministry of Business, Innovation and Employment. It is effective from 1 January 2017 and supersedes all previous versions of this document.

The previous version of this document (Amendment 3) will cease to have effect on 30 May 2017.

People using this document should check for amendments on a regular basis. The Ministry of Business, Innovation and Employment may amend any part of any Verification Method or Acceptable Solution at any time. Up-to-date versions of Verification Methods and Acceptable Solutions are available from [www.building.govt.nz](http://www.building.govt.nz)

<b>F6: Document History</b>			
	<b>Date</b>	<b>Alterations</b>	
First published	July 1992		
Amendment 1	1 December 1995	pp. i and ii, Document History p. iii, F6.3.1 p. v, Contents p. vi, References	p. 3, 1.2.1, 1.3 pp. 4 and 5, Table A1 p. 7, Index
Reprinted incorporating Amendment 1	July 1996		
Second edition	1 December 2000 Effective from 1 June 2001	Document revised – second edition issued	
Amendment 1	21 June 2007	Name of Compliance Document amended throughout pp. 3 and 4, new Building Code Clause F6	
Third Edition	18 October 2007	Document revised – Third edition issued	
Amendment 2	Effective from 10 October 2011 until 14 August 2014	p. 2, Document History, Status p.7, References	
Amendment 3	14 February 2014 until 030 May 2017	p. 2A, Document History, Status p.7, References	p. 9 Definitions p. 13, F6/AS1 1.2
Amendment 4	Effective 1 January 2017	p. 13 F6/AS1 1.2 pp. 16-17 F6/AS1 Appendix A p. 23 Index	
<b>Note: Page numbers relate to the document at the time of Amendment and may not match page numbers in current document.</b>			



# New Zealand Building Code

## Clause F6 Visibility in Escape Routes

The mandatory provisions for building work are contained in the New Zealand Building Code (NZBC), which comprises the First Schedule to the Building Regulations 1992. The relevant NZBC Clause for Visibility in Escape Routes is F6.

SR2007/124

### Clause F6–Visibility in escape routes

#### Provisions

##### Objective

**F6.1** The objective of this provision is to help safeguard people from injury in *escape routes* during failure of the main lighting.

#### Functional requirement

**F6.2** *Specified features in escape routes* must be made *reasonably visible* by lighting systems, other systems, or both, during failure of the main lighting.

#### Performance

**F6.3.1** *Specified features in escape routes* must, when the systems for visibility are at their design level, be *reasonably visible*.

**F6.3.2** The systems for visibility must operate to the following percentages of their design levels within the following times after failure of the main lighting:

- (a) 80% in 0.5 seconds in locations (examples of which are given by performance F6.3.3) where there is a high risk of injury due to delay in operation of the systems for visibility; and
- (b) 10% in 0.5 seconds, and 80% in 30 seconds, in stairs and in locations that are unfamiliar to users; and
- (c) 10% in 20 seconds, and 80% in 60 seconds, in all other locations.

**F6.3.3** Examples of locations (referred to in performance F6.3.2(a)) where there is a high risk of injury due to delay in operation of the systems for visibility include:

#### Limits on application

Requirement F6.2 does not apply to *Detached Dwellings, household units* within *Multi-unit Dwellings, Outbuildings, or Ancillary buildings*.

Performance F6.3.1 does not apply to *specified features* in the initial 20 metres of an *escape route* if the risk of injury, or impediment to movement of people, due to the *specified features* not being visible is low (for example, because people are familiar with the *escape route*, the *escape route* is level, and people do not require assistance to escape).

**SR2007/124**

---

**Provisions***Performance*—continued

- (a) areas where dangerous machinery is installed:
- (b) areas where hazardous processes take place:
- (c) clinical areas of hospitals:
- (d) prisons and other *buildings* in which people are detained:
- (e) any part of an *escape route* designed for use at any time by more than 250 people.

**F6.3.4** The systems for visibility must operate continuously in *buildings* or parts of buildings in the following risk groups for the following periods after failure of the main lighting:

- (a) *risk group A*, until restoration of the main lighting system:
- (b) *risk group B*, 90 minutes:
- (c) *risk group C*, 30 minutes.

**F6.3.5** Despite performance F6.3.4, if a *building* or part of a *building* falls into both *risk group A* and *risk group B*, the systems for visibility must operate for whichever is the longer of the periods specified in performance F6.3.4(a) and (b).

**F6.3.6** Signs to indicate escape routes must be provided as required by Clause F8 “Signs”.

**Limits on application**

# Contents

	<b>Page</b>
<b>References</b>	<b>7</b>
<b>Definitions</b>	<b>9</b>
<b>Verification Method F6/VM1</b>	<b>11</b>
<b>Acceptable Solution F6/AS1</b>	<b>13</b>
1.1 Scope	13
1.2 Location	13
1.3 Illuminance	13
1.4 Method of Measurement	14
1.5 Start-up and Light Output	14
1.6 Duration	14
1.7 Documentation	15
1.8 Installation, Maintenance and Equipment	15
<b>Appendix A – Occupant Densities</b>	<b>16</b>
<b>Appendix B – Modifications to AS 2293.1: 2005 and AS 2293.3: 2005</b>	<b>18</b>
<b>Appendix C – Modifications to NZS 6104</b>	<b>21</b>
<b>Appendix D – Measurement of escape route travel distance</b>	<b>22</b>
<b>Index</b>	<b>23</b>





# References

For the purposes of New Zealand Building Code (NZBC) compliance, the Standards and documents referenced in this Verification Method and Acceptable Solution (primary reference documents) must be the editions, along with their specific amendments, listed below. Where these primary reference documents refer to other Standards or documents (secondary reference documents), which in turn may also refer to other Standards or documents, and so on (lower-order reference documents), then the version in effect at the date of publication of this Verification Method and Acceptable Solution must be used.

Amend 2  
Oct 2011Amend 3  
Feb 2014Amend 3  
Feb 2014

## Standards New Zealand

- NZS 4332: 1997 Non-domestic passenger and goods lifts
- NZS 6104: 1981 Specification for emergency electricity supply in buildings

## Standards Australia

Amend 3  
Feb 2014  
Amend 2  
Oct 2011

- AS 2293: Emergency evacuation lighting for buildings
- Part 1: 2005 System design, installation and operation  
*Amend: 1*

Amends  
2 and 3

- Part 3: 2005 Emergency escape luminaires and exit signs  
*Amend: 1*

## Standards – Australia/New Zealand

Amend 2  
Oct 2011  
Amend 3  
Feb 2014

- AS/NZS 1680.1: 2006 Interior and workplace lighting:  
General principles and recommendations
- AS/NZS 2293:- Emergency evacuation lighting for buildings
- Part 2: 1995 Inspection and maintenance  
*Amends: 1, 2, 3*

## Where quoted

AS1 1.2 Comment

AS1 1.8.2

AS1 1.8.1, 1.8.2

AS1 1.8.1

AS1 1.4.1

AS1 1.8.3



# Definitions

This is an abbreviated list of definitions for words or terms particularly relevant to this Verification Method and Acceptable Solution. The definitions for any other italicised words may be found in the New Zealand Building Code Handbook.

Amend 3  
Feb 2014

**Building** has the meaning ascribed to it by sections 8 and 9 of the *Building Act 2004*.

**Building consent** means a consent to carry out *building work* granted by a *building consent authority* under section 49 of the *Building Act 2004*.

**Building height** means the vertical distance between the floor of the lowest *final exit* from the *building*, and the highest occupied floor level containing or supporting any *purpose group* other than IE, IA or ID, or penthouses used to enclose *stairways*, lift shafts or machinery rooms located on or within the roof.

**Classified use** means a *classified use* listed in clause A1 of the *Building Code*.

**Exitway** means all parts of an *escape route* protected by *fire* or *smoke separations*, or by distance when exposed to open air, and terminating at a *final exit*.

**Final exit** The point at which an *escape route* terminates by giving direct access to a *safe place*.

#### COMMENT:

*Final exits* are commonly the external doors from a ground floor, but this applies only if such doors open directly onto a *safe place*. If a *safe place* can be reached only by passing down an alley, or across a bridge, then the *final exit* is not reached until the end of such an alley or bridge. *Final exits*, therefore, should be seen strictly as a point of arrival, rather than as any particular element of a *building*. They are determined entirely by the definition of *safe place*.

**Illuminance** means the luminous flux falling on to a unit area of surface.

**Reasonably visible**, in relation to a *specified feature*, and for the purposes of Clause F6, means that the *specified feature* is visible to a person who—

- (a) is 10 metres from it, or the greatest distance from it that it is possible to go in the open space surrounding it, whichever is the lesser; and
- (b) has sight that is not defective, or is corrected (for example, by an optical appliance).

**Risk group A**, for the purposes of performance F6.3.4 and performance F6.3.5, means *buildings*—

- (a) whose occupants are required to remain in the *building* until the main lighting system is restored; or
- (b) whose *evacuation time* is longer than 90 minutes.

**Risk group B**, for the purposes of performance F6.3.4 and performance F6.3.5, means *buildings*—

- (a) whose *evacuation time* is 30 minutes or longer but not longer than 90 minutes; or
- (b) whose occupant load is more than 1,000.

**Risk group C**, for the purposes of performance F6.3.4, means *buildings* not in *risk group A* or *risk group B*.

**Safe place** A place of safety in the vicinity of a *building*, from which people may safely disperse after escaping the effects of a *fire*. It may be a place such as a street, *open space*, public space, or an *adjacent building*.

**Specified features**, for the purposes of Clause F6, means the following:

- (a) **building elements** that may act as obstructions:
- (b) safety features required under clauses of the *Building Code* other than Clause F6 (for example, *handrails* required under Clause D1):
- (c) changes in direction:
- (d) stairs and ramps:
- (e) escape doors:
- (f) entries to a *safe place*.

**Travel Distance** The length of the *escape route* as a whole or the individual lengths of its parts, namely:

- (a) *Open paths*;
- (b) *Protected paths*; and
- (c) *Safe paths*.



# Verification Method F6/VM1

No specific test methods have been adopted for verifying compliance with the Performance of NZBC F6.



# Acceptable Solution F6/AS1

## Emergency Lighting Location, Illuminance and Installation

### 1.1 Scope

This Acceptable Solution applies to situations where emergency lighting is used as the sole means of meeting the performance requirements of Clause F6.

This Acceptable Solution does not apply to lighting that is essential to maintain safe working conditions.

#### COMMENT:

1. This Acceptable Solution is for illuminance-based emergency lighting systems only.
2. Examples of situations where lighting is essential to maintain safe working conditions include rotating machinery, operating theatres, and handling hazardous substances and organisms.
3. It should be noted that, irrespective of whether or not emergency lighting is required, the provision of signs must comply with Clause F8.

### 1.2 Location

Emergency lighting must be provided in all of the following:

- (a) in all *exitways*,
- (b) at every change of level in an *escape route*,
- (c) in an *escape route* from the point where the initial *open path travel distance* exceeds 20 metres,
- (d) in any *occupied space* designed for an *occupant load* of more than 250 people including all *escape routes* serving that space,
- (e) in any part of an *escape route* designed to serve more than 250 people,
- (f) in the *escape routes* of the *classified use* Community Care.

#### COMMENT:

1. To determine the *occupant load* of a floor refer to section 1.4 of C/AS1 through to C/AS6 as appropriate.
2. Paragraph 1.2 (b) applies to stairs, steps, ramps etc. A slope with a gradient steeper than 1 in 20 is considered a ramp for the purposes of this paragraph.
3. Paragraph 1.2 (c) recognises that people can find their way in darkness over relatively short distances to areas provided with acceptable visual conditions. Acceptable visual conditions can be provided either by an illuminated floor surface complying with Paragraphs 1.3.1 and 1.3.2 (a) or by directly visible illuminated areas complying with Paragraph 1.3.2 (b).
4. Examples of 20 metre travel distance measurement are given in Appendix D.
5. To reach a *safe place* the *escape route* may include an external portion. The requirements of this Acceptable Solution also apply to this external portion.
6. Lighting for emergency in lifts is contained in Acceptable Solution D2/AS1, which references NZS 4332.

Amend 4  
Jan 2017

Amend 3  
Feb 2014

### 1.3 Illuminance

**1.3.1** Where required by Paragraph 1.2, emergency lighting must provide a direct *illuminance* of no less than:

- (a) 1 lux in *exitways*, and
- (b) 1 lux at every change in level in an *escape route*, and
- (c) 0.2 lux everywhere else.

**1.3.2** As an alternative to Paragraph 1.3.1, specific *escape routes* must be identified and provided with a direct *illuminance* of no less than:

- (a) 1 lux in *exitways* and 1 lux throughout the route, or
- (b) 10 lux across the width of the route with a uniformity ratio along the route of not greater than 100:1 (maximum to minimum) and 10 lux at changes of direction, changes of level and where the route enters an *exitway* or *final exit*.

**1.3.3** For certain *buildings* or portions of *buildings* the *illuminance* specified in Paragraphs 1.3.1 and 1.3.2 may be insufficient. For locations such as noted in (a) to (d) below, Paragraphs 1.3.1 and 1.3.2 are therefore not applicable and the *illuminance* levels are to be determined by specific design:

- (a) areas with dangerous machinery,
- (b) areas containing hazardous processes,
- (c) clinical areas of hospitals, and
- (d) prisons and other places of detention.

#### 1.4 Method of Measurement

**1.4.1** *Illuminance* must be measured in accordance with Appendix B of AS/NZS 1680.1

**1.4.2** Measurements must be made at floor level.

**1.4.3** Measurements must not be made within 500 mm of vertical surfaces. Minimum *illuminance* will generally occur furthest from the luminaire(s) and at least four measurements shall be made around each luminaire on both axes. If the layout of luminaires is symmetrical, the number of measurements may be reduced.

**1.4.4** Daylight or spill light from adjacent rooms must be excluded and the lamps switched on and allowed to stabilise prior to measurements being taken.

#### 1.5 Start-up and Light Output

**1.5.1** The emergency lighting system must initiate within the following times and provide:

- (a) 80% of design *illuminance* level in 0.5 seconds in locations where there is a high risk of injury due to delay in operation of the emergency lighting, such as:
  - (i) areas with dangerous machinery,
  - (ii) areas containing hazardous processes,
  - (iii) clinical areas of hospitals,
  - (iv) prisons and other places of detention, and
  - (v) any part of an *escape route* designed for more than 250 people.
- (b) 10% of design *illuminance* level in 0.5 seconds and 80% design *illuminance* level in 30 seconds in stairs or locations where the majority of the occupants/users are not familiar with the space, and
- (c) 10 % of the design *illuminance* level in 20 seconds and 80% of the design *illuminance* level in 60 seconds in all other locations.

#### 1.6 Duration

**1.6.1** Emergency lighting must be maintained for the following durations:

- (a) Continuously in *buildings* or parts of *buildings* where the occupants are required to remain in the *building* until the main lighting system is restored, or *buildings* that have an evacuation time of over 90 minutes,
- (b) 90 minutes for *buildings* with an:
  - (i) *Escape height* over 150 metres, or
  - (ii) Evacuation time between 30 and 90 minutes, or
  - (iii) Occupant load over 1000
- (c) 30 minutes for all other *buildings*.



## 1.7 Documentation

**1.7.1** Where Paragraph 1.3.2 is used, the specific *escape routes* must be identified on the *building consent* drawings.

**1.7.2** As part of the *building consent* application, the owner of the proposed emergency lighting system must submit documentation that provides:

- (a) full technical justification of the design,
- (b) the method of checking the *illuminance* of the completed design, and
- (c) the method of checking ongoing compliance for the life of the *building*.

### COMMENT:

Acceptable methods of checking the illumination of the completed installation include:

- (a) *illuminance* measurements conforming with the method provided in Paragraph 1.4.1.
- (b) site verification that the luminaire type and spacing comply with the computer-based design or the manufacturer's spacing tables submitted as part of the *building consent* application.

**1.8.2** Notwithstanding the requirements of Paragraph 1.8.1 (a) a generator installed and maintained in accordance with NZS 6104, as amended by Appendix C, is an acceptable emergency power supply to meet Section 3 of AS 2293: Part 1 providing the emergency lighting has priority as the initial load.

**1.8.3** Inspection, maintenance and reporting procedures for central battery and single point systems shall be performed in accordance with AS/NZS 2293: Part 2.

### COMMENT:

For Paragraph 1.8.2 the starting characteristics of generators make them unsuitable as initial power sources in situations where NZBC Performance Requirements F6.3.2(a) and (b) must be satisfied.

## 1.8 Installation, Maintenance and Equipment

**1.8.1** An emergency lighting system must be installed in accordance with:

- (a) AS 2293: Parts 1 and 3 as amended by Appendix B (F6/AS1), and
- (b) NZBC Clause G9, Electricity.

Emergency lighting installations must be commissioned after the successful completion of tests to confirm automatic operation upon tripping or failure of the power supply to the normal lighting circuits and must include testing of any phase failure devices. Such tests must be repeated on the completion of any addition to, or alteration of, the installed system.

# Appendix A – Occupant Densities

**Appendix A deleted by  
Amendment 4, 1 January 2017**



# Appendix B – Modifications to AS 2293.1: 2005 and AS 2293.3: 2005

## PART 1

### Section 2 – System Performance, Arrangement and Control

---

#### 2.3.1 General

Add Note after paragraph –

Note – Where generators are used as a means of electrical supply for the emergency lighting system the generator installation must comply with NZS 6104 as amended by Appendix C of F6/AS1.

#### 2.3.3.1 Centrally supplied systems

Add after first paragraph –

“Where a generator is used as the means of providing emergency power it must start if any of the final sub-circuit sensors detect the loss of power to a final sub-circuit.”

### Section 3 – Emergency Lighting Power Sources

---

**3.2.2 Fire Resistance** – Delete

**3.2.4.3 Maintenance of Fire Resistance**  
– Delete

### Section 5 – Design of Emergency Escape Luminaire Installations

---

#### 5.2 Provision of Emergency Luminaires

Amend the first paragraph to read “Emergency luminaires must be installed throughout the designated area in accordance with New Zealand Building Code Clause F6”. Delete last sentence of the first paragraph.

#### 5.4.2.1 General

Delete (a)

#### 5.4.2.3 Illuminance Calculations

Delete “...is not less than 0.2 lux” and add “...is as required by the New Zealand Building Code Clause F6”.

**Tables 5.1 to 5.5 inclusive** – Delete tables.

Note – Spacing tables specifically designed to comply with the requirements of the New Zealand Building Code Clause F6 may be used to position emergency lighting luminaires in New Zealand.

#### 5.6.1 General

Delete (a)

#### 5.6.2 Direct Lighting (Spacing Rules)

– Delete clause

Note – Spacing tables specifically designed to comply with the requirements of the New Zealand Building Code Clause F6 may be used to position emergency lighting luminaires in New Zealand.

#### 5.6.3 Direct Lighting (Illuminance Calculations)

Delete “not less than 1 lx.” Replace with “as required by F6/AS1 Paragraph 1.3.”

#### 5.6.4 Indirect Lighting (Illuminance Calculations)

Delete “not less than 1 lx.” Replace with “as required by F6/AS1 1.3.”

### Section 6 – Design of Exit Signs, Installation

---

#### 6.2 Required Locations

Delete “...Building Code of Australia” and add “New Zealand Building Code Clause F6”.

#### 6.3 Use of Externally Illuminated Signs

Delete clause and add “Installation of external illuminated exit signs must comply with the requirements of New Zealand Building Code Clause F8”. Retain the Note.

#### 6.4 Sign Colours

Delete Clause 6.4.1, Areas of normal illumination and 6.4.2, Area of low illumination and refer to New Zealand Building Code Clause F8.

**6.5 Choice of Images**

Delete and refer to New Zealand Building Code Clause F8.

**6.6 Size of Pictorial Element**

Delete

**6.7 Illumination**

Delete "Building Code of Australia" and add "New Zealand Building Code Clauses F6 and F8..."

**Section 7 – Installation of Electrical Wiring and Equipment for Centrally Supplied Systems**

---

**7.4 Protection of the Electrical Installation Against Fire**

Delete

**7.5 Segregation or Identification of Submains**

Change the last sentence to read "Where emergency lighting submain conductors are of different voltages to the normal supply they must not be installed in the same conduit, duct or troughing." Retain second sentence.

**Appendix A**

Add: AS/NZS 1680.1: 2006 Interior and workplace lighting: General principles and recommendations

NZS 6104: 1981 Specification for emergency electricity supply in buildings

NZS 6742: 1971 Code of practice for emergency lighting in buildings

**Appendix B** – Delete

**Appendix C** – Delete figures C3, C4, C5, C6, C7 and C8

**Appendix D** – Delete

**PART 3**

**Section 2 – General Requirements for Emergency Escape Luminaires**

---

**2.3 Illumination at switch on**

**2.3.1 Maximum delay** Emergency luminaires must provide a light output as specified in F6/AS1 Paragraph 1.5.

Delete (a) and (b) and the sentence following.

Amend the beginning of Paragraph 3 to read "These requirements shall apply ...."

Delete the Note.

**Section 3 – General requirements for exit signs**

---

Delete entire section.

**Section 4 – Particular requirements for self-contained emergency luminaires and exit signs**

---

Delete all references to Exit Signs – these are required to comply with New Zealand Building Code Clause F8.

**4.8.3 Required indication**

Paragraph after (c) change to read "Where a single indicator is used to provide all of the indications required by items (a) to (c), the following illuminated states shall have the meanings given:"

**Appendix C** Classification of emergency escape luminaires

Attention is drawn to the need to provide spacing tables that comply with the New Zealand requirements for the required illumination levels. The basic formulae and methods of deriving classifications and spacing tables remain the same. Clause 2.2 and Appendix C of this Standard may be used to formulate appropriate spacing tables for New Zealand requirements.

**AS/NZS 2293.2: 1995  
(including amendment 1)**


No changes are required to this Standard.

# Appendix C – Modifications to NZS 6104

Clause 302.1 “Response Criteria” shall be amended to read:

“The emergency plant must be such that full speed is attained and initial load applied within a maximum of 15 seconds from the initiating signal.”

# Appendix D – Measurement of escape route travel distance F6/AS1 1.2 (c)

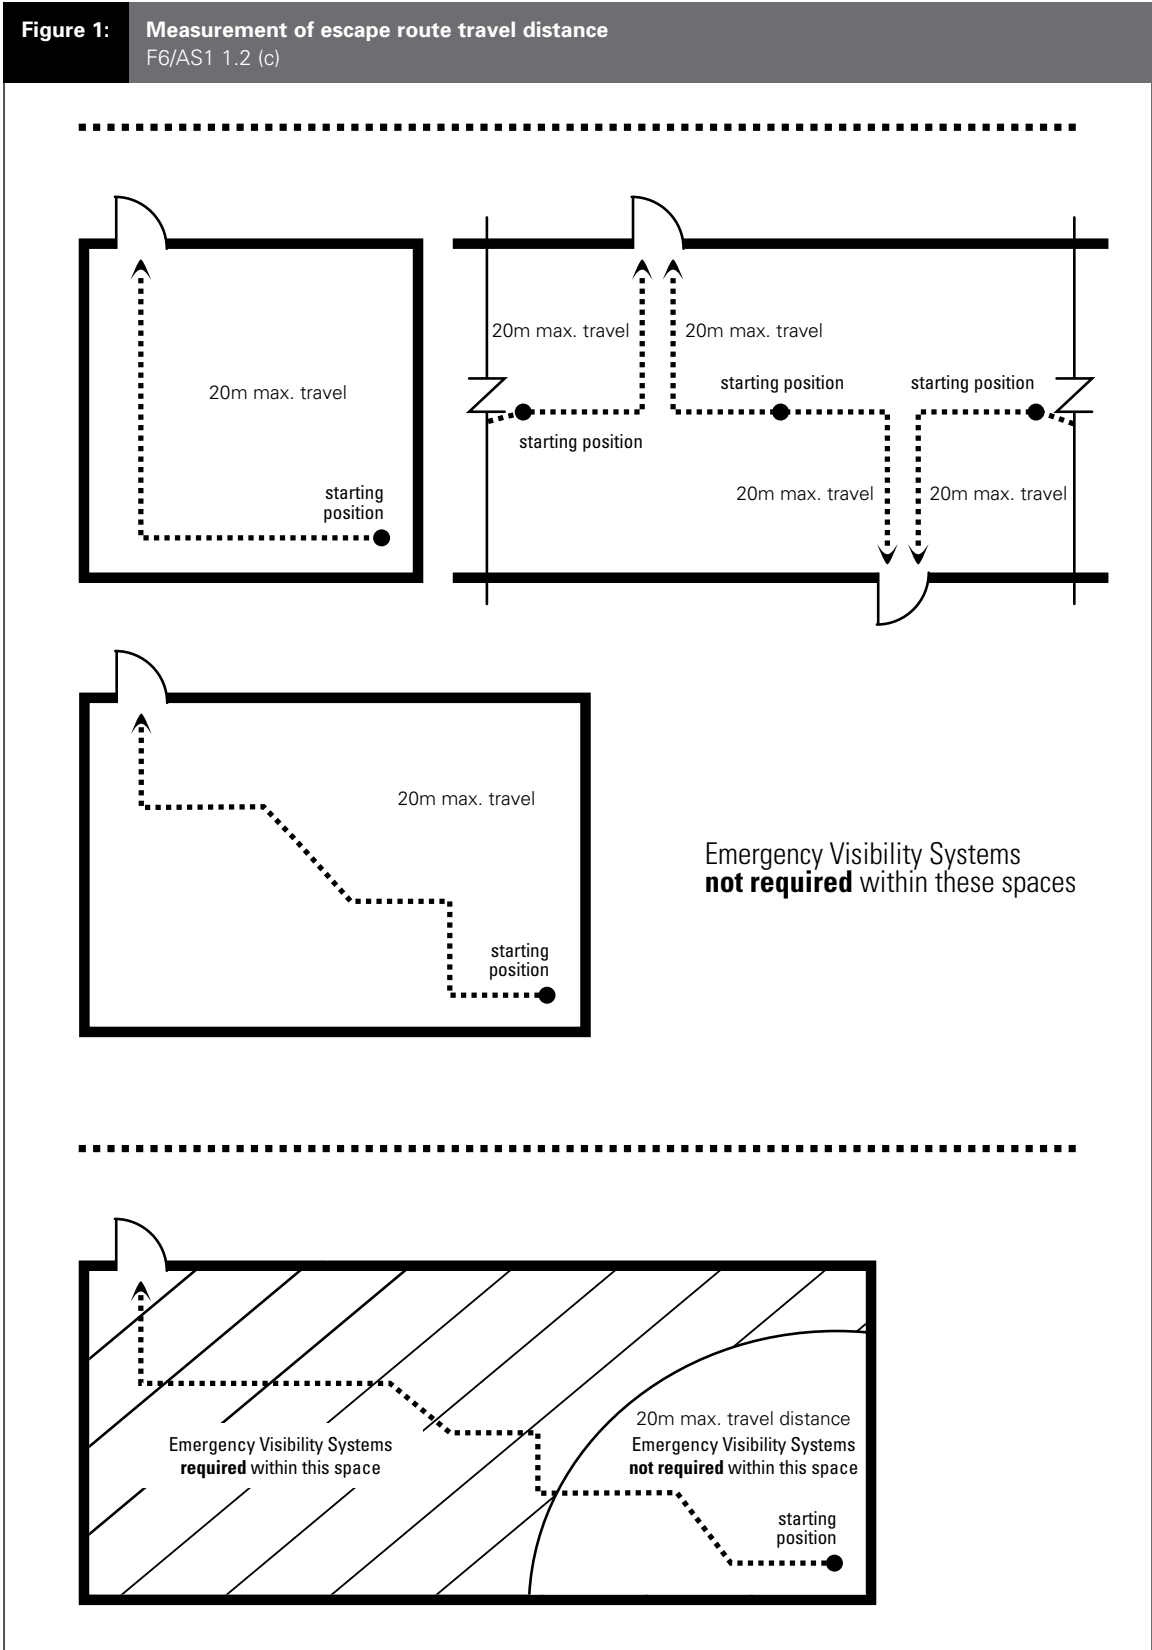



# Index F6/MM1 & AS1

References are to Paragraphs.

## Visibility in Escape Routes

Duration . . . . .	<b>AS1</b>	1.6
Documentation . . . . .	<b>AS1</b>	1.7
Equipment . . . . .	<b>AS1</b>	1.8
Illuminance . . . . .	<b>AS1</b>	1.3
Installation . . . . .	<b>AS1</b>	1.8
Location . . . . .	<b>AS1</b>	1.2
Maintenance . . . . .	<b>AS1</b>	1.8
Method of Measurement . . . . .	<b>AS1</b>	1.4
Light Output . . . . .	<b>AS1</b>	1.5
Scope . . . . .	<b>AS1</b>	1.1
Start-up . . . . .	<b>AS1</b>	1.5

Amend 4 |  
Jan 2017 |

## Modifications to AS 2293.1: 2005

and AS 2293.3: 2005 . . . . . Appendix B

Modifications to NZS 6104 . . . . . Appendix C

Measurement of escape route travel distance . . . . . Appendix D

